
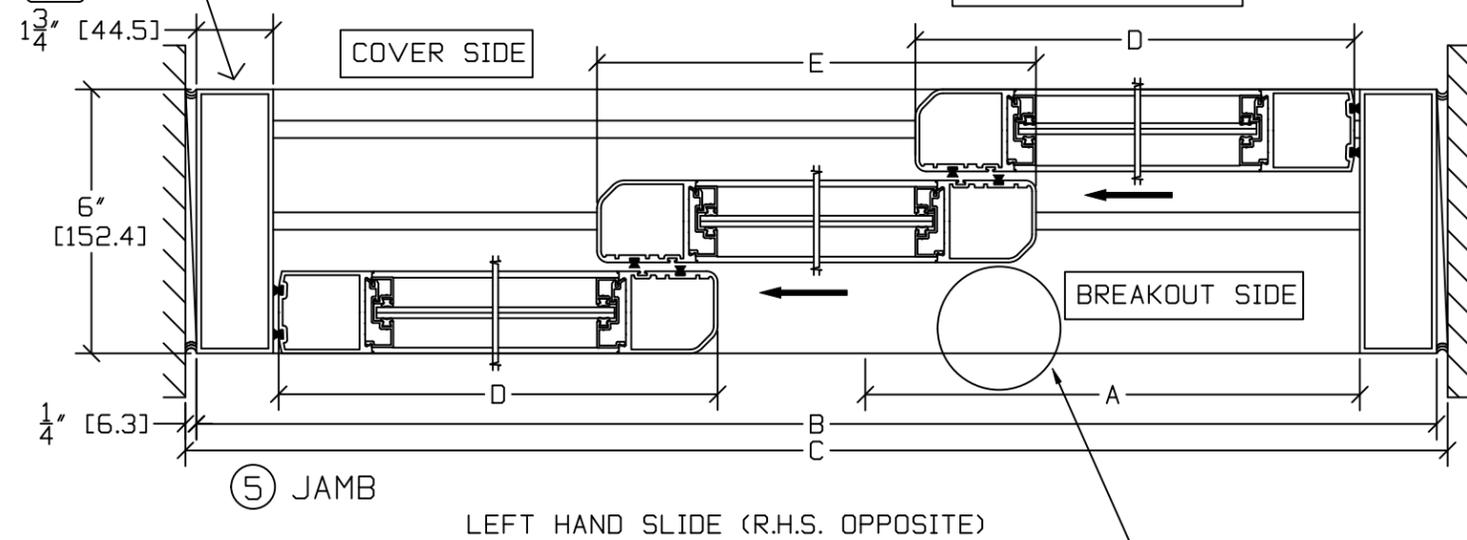
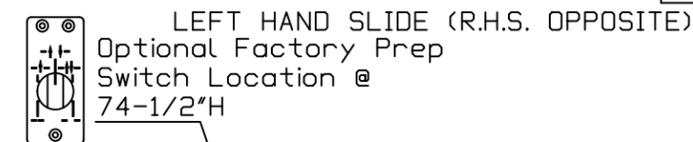


ASSA ABLOY SL500 CONCEALED, FULL BREAKOUT, SINGLE SLIDE TELESCOPIC SLIDING DOOR SYSTEM

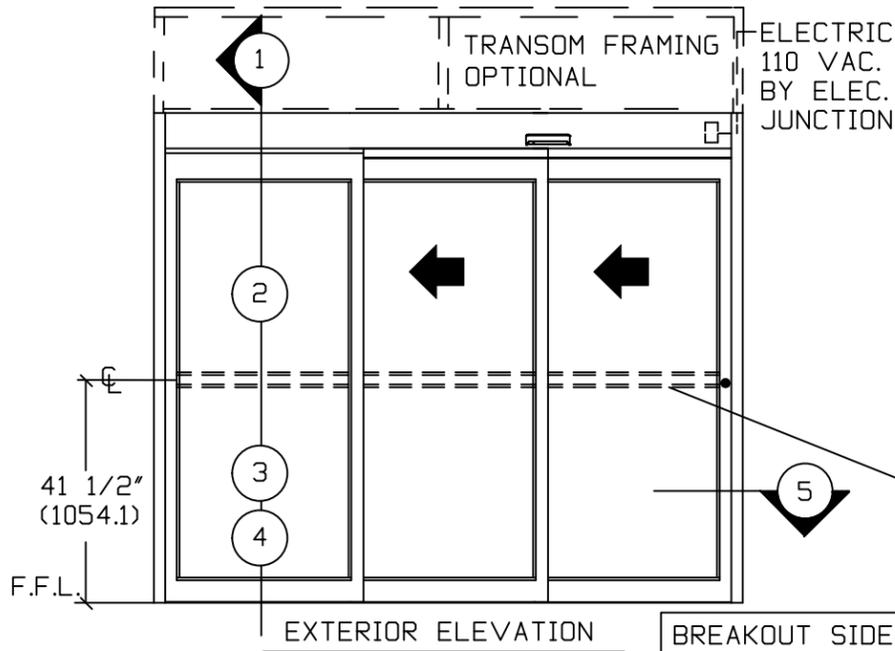


SL500 OHC	DOOR OPENING A	OVERALL FRAME WIDTH B	MASONRY OPENING WIDTH C	ACTIVE & SIDELITE LEAF WIDTH D & E
6'	36 7/16" (925.5)	72" (1828.8)	72 1/2" (1841.5)	24 9/16" (623.9)
7'	44 7/16" (1128.7)	84" (2133.6)	84 1/2" (2146.3)	28 9/16" (725.5)
8'	52 7/16" (1331.9)	96" (2438.4)	96 1/2" (2451.1)	32 9/16" (827.1)
9'	60 7/16" (1535.1)	108" (2743.2)	108 1/2" (2755.9)	36 9/16" (928.7)
10'	68 7/16" (1738.3)	120" (3048)	120 1/2" (3060.7)	40 9/16" (1030.3)
11'	76 7/16" (1941.5)	132" (3352.8)	132 1/2" (3365.5)	44 9/16" (1131.9)
12'	84 7/16" (2144.7)	144" (3657.6)	144 1/2" (3670.3)	48 9/16" (1233.5)
KEY	(2B/3)-11 9/16 (2B/3)-(293.7)	(C-1/2") (C-12.7)	(B+1/2") (B+12.7)	(B/3)+9/16" (B/3)+(14.3)

FINISHED FLOOR
MUST NOT BE AN
INCREASE IN
ELEVATION THROUGH
BREAKOUT DOOR(S)

FINISHED FLOOR
MUST NOT BE
CONCAVE ACROSS
THE CLEAR
DOOR OPENING
AND NOT OUT
OF LEVEL MORE
THAN 1/4" (TYP)



STD. GLASS SIZE KEY*	WIDTH - 'D' & 'D'	(B/3)-4 1/4" (B/3)-(107.95)
	WIDTH- 'E'	(B/3)-4 3/8" (B/3)-(111.13)
	HEIGHT	OFH-15 7/8" OFH-(403.2)

* NARROW STILE RAILS w/ 1/4" GUTTER, NO MUTTINS

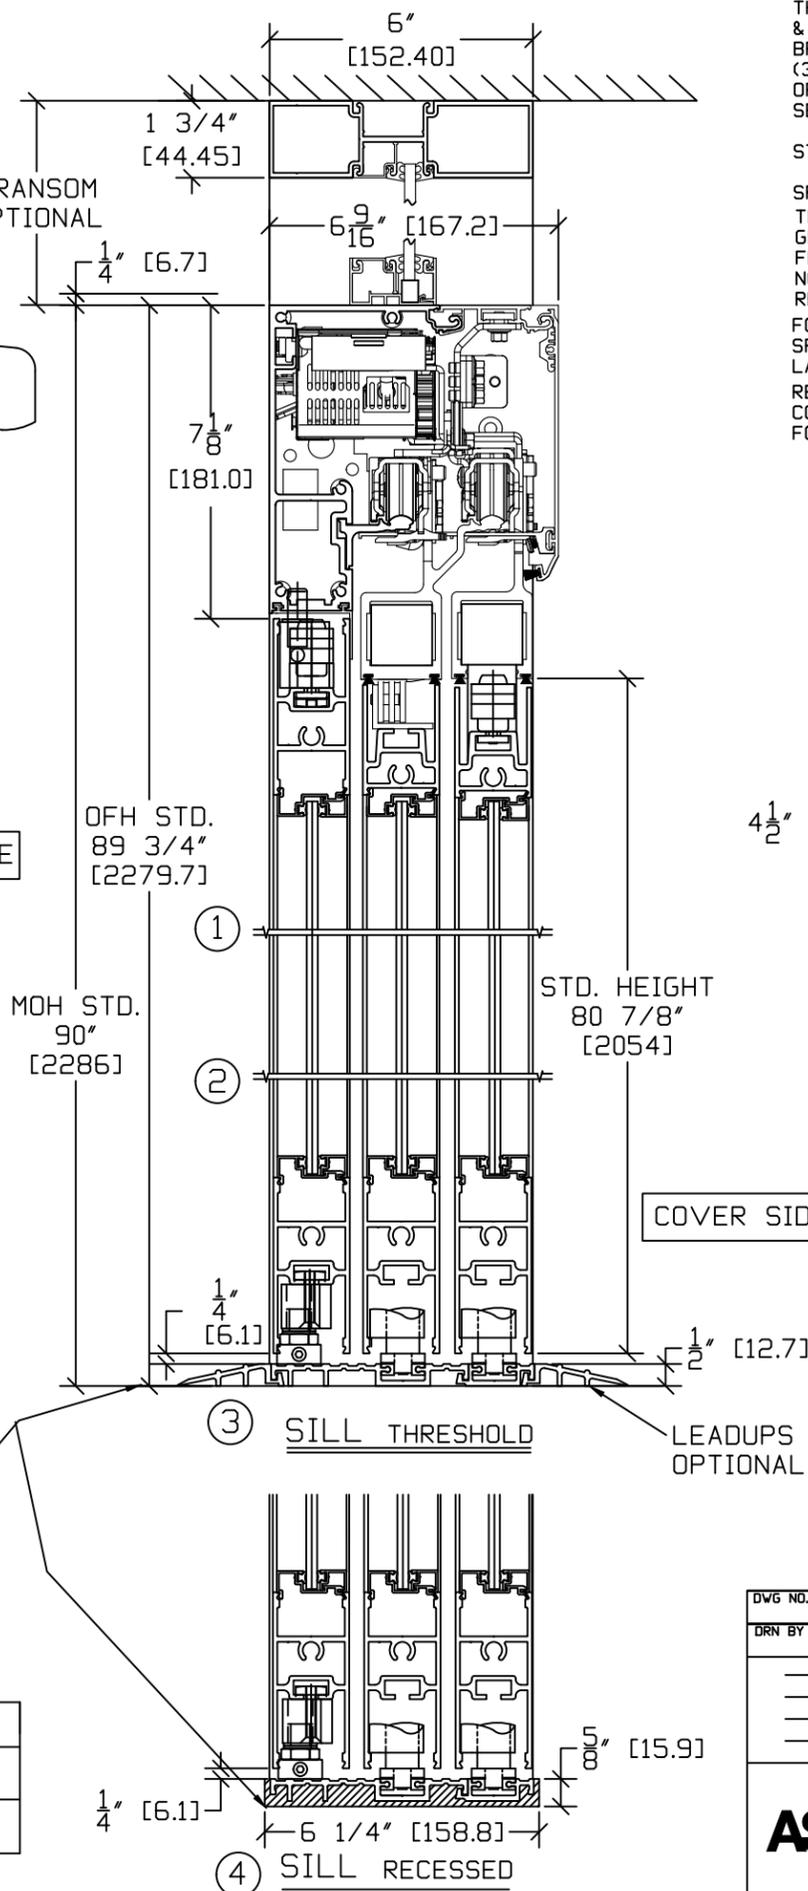

NOTE: THE STANDARD PACKAGE CONSISTS OF:
THE AUTOMATIC OPERATOR & WEATHERSTRIP, FRAMES, DOORS
& SIDELITES WITH VERTICAL WEATHERSTRIP, EMERGENCY
BREAKAWAY, 2-POINT LOCK, OPTIONAL POSITION SWITCHES (DIGITAL
(3 OR 5) OR KEY (5)), (OFF-EXIT ONLY-AUTO-REDUCED
OPENING-HOLD OPEN OR OFF, AUTO, HOLD OPEN), MOTION/PRESENCE
SENSORS.

STANDARD FINISH: CLEAR- AA-M12C22A41, CLASS 1, .018 MM.
DARK BRONZE- AA-M12C22A44, CLASS 1, .018 MM.
SPECIAL FINISHES ARE AVAILABLE.
THIS PACKAGE WILL ACCEPT UP TO 1"(25.4) INSULATED GLASS.
GLASS OVER 1/4" WILL REQUIRE THE HEADER TO BE SUPPORTED
FROM ABOVE.
NOTE DRAWING IS DIMENSIONED IN BOTH ENGLISH AND METRIC
REF. AS FOLLOWS 1" (25.4) ALL METRIC SIZES ARE MILLIMETERS.
FOR MAXIMUM CURRENT DRAW PER OPERATOR, SEE PRODUCT
SPECIFICATION, INSTALLATION INSTRUCTIONS, OR THE UL
LABEL ON THE EQUIPMENT.
REFER TO RELEVANT (LOCAL, STATE, NATIONAL OR AHJ) BUILDING
CODE FOR MIN DOOR HEIGHT & MIN/MAX WIDTH ALLOWABLE
FOR EGRESS REQUIREMENT IN CONJUNCTION WITH TABLE BELOW.

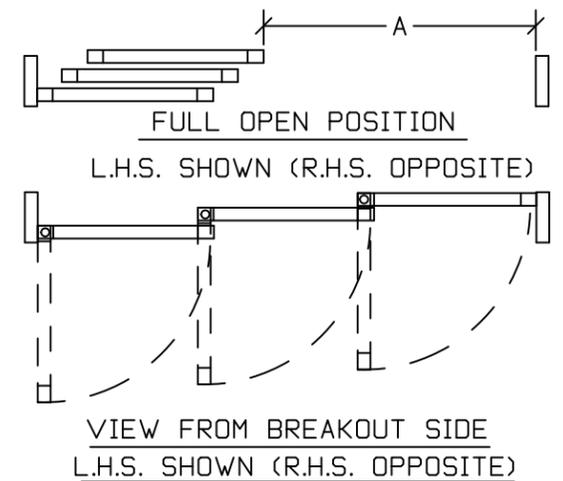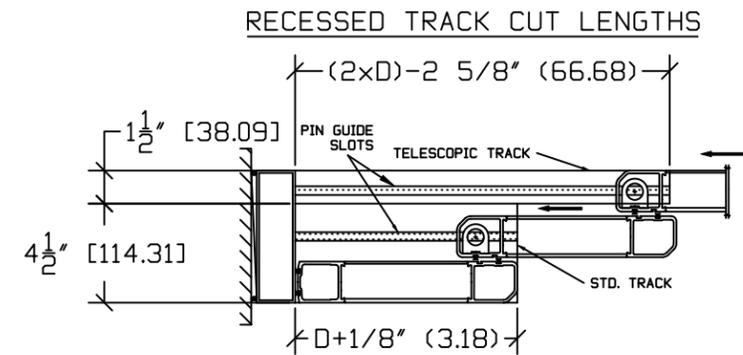

DWG NO. 1010834	DRN BY CLW	DATE 6/4/13	CHK BY SS	DATE 6/4/13	REV. 5.0	DATE 01/18/22
-----------------	------------	-------------	-----------	-------------	----------	---------------