


Description	Accessory Board
Remarks	<ul style="list-style-type: none"> <li>Accessory Board is Mounted in Header to the Right of the Control.</li> <li>Required for the Use of the Rotary Mode Selector and Remote Control/Night Mode</li> </ul>

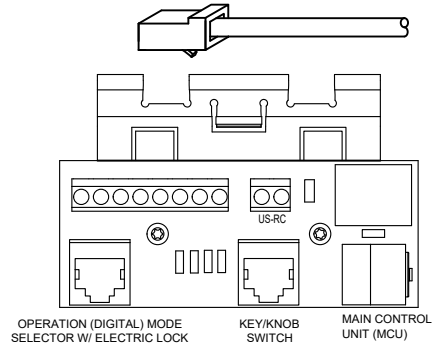


### Connections

Connections are to be dry.

Card readers are wired to terminals 8 and 12;

0 VDC and Key Impulse terminals are labeled on bottom of the control.

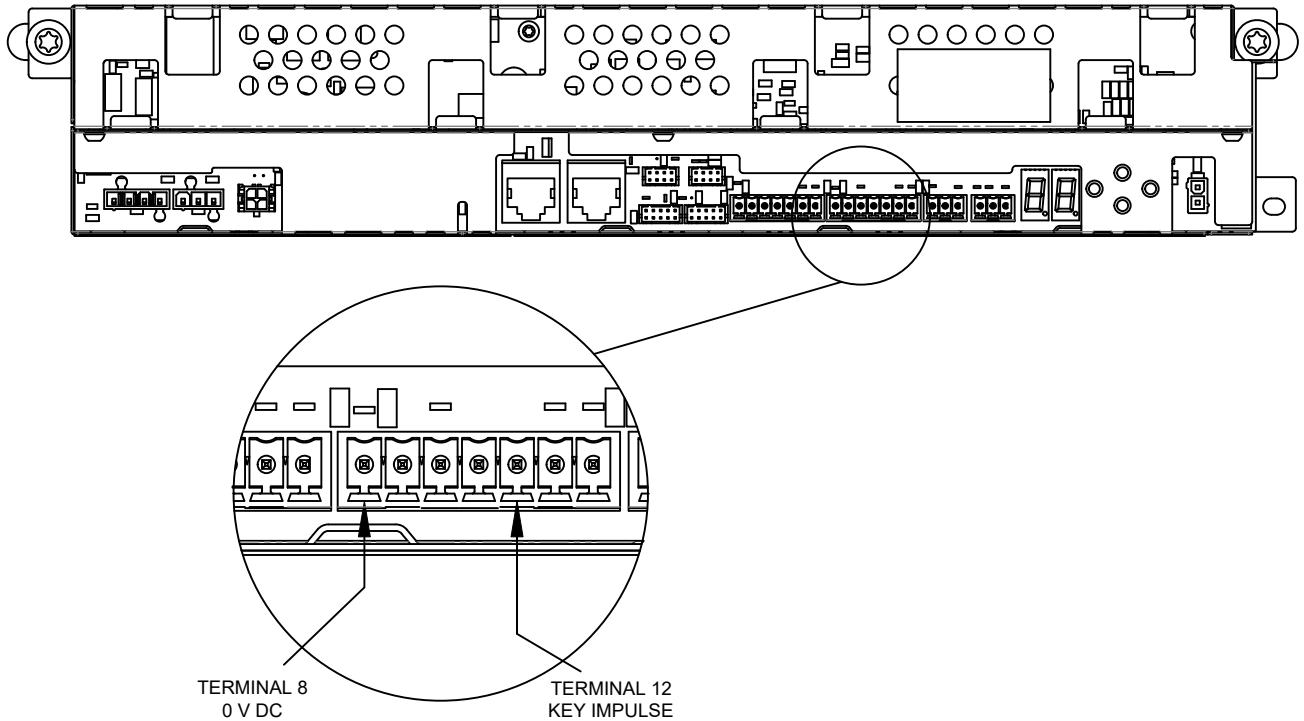

### NOTES:

KEY/ KNOB SWITCH ALWAYS PLUGS INTO ACCESSORY BOARD PORT.  
US-RC : REMOTE CONTROL / NIGHT MODE

- REMOTE CONTROL / NIGHT MODE WILL OVERRIDE THE MODE SELECTOR AND PLACE THE DOOR IN EXIT ONLY MODE AND ENGAGE THE ELECTRIC LOCK FOR SECURITY PURPOSES. SIGNAL CONTROLLED BY BUILDING SECURITY SYSTEM.
- REMOTE CONTROL / NIGHT MODE REQUIRES A NORMALLY OPEN DRY CONTACT. THE CIRCUIT MUST BE CLOSED FOR NIGHT MODE.
- CARD READERS ARE WIRED TO TERMINALS 8 AND 12.

DWG NO. 1022560											
DRN BY	CAT	DATE	07/07/2021	CHK BY	SS	DATE	07/07/2021	REV.	1.0	DATE	07/07/2021